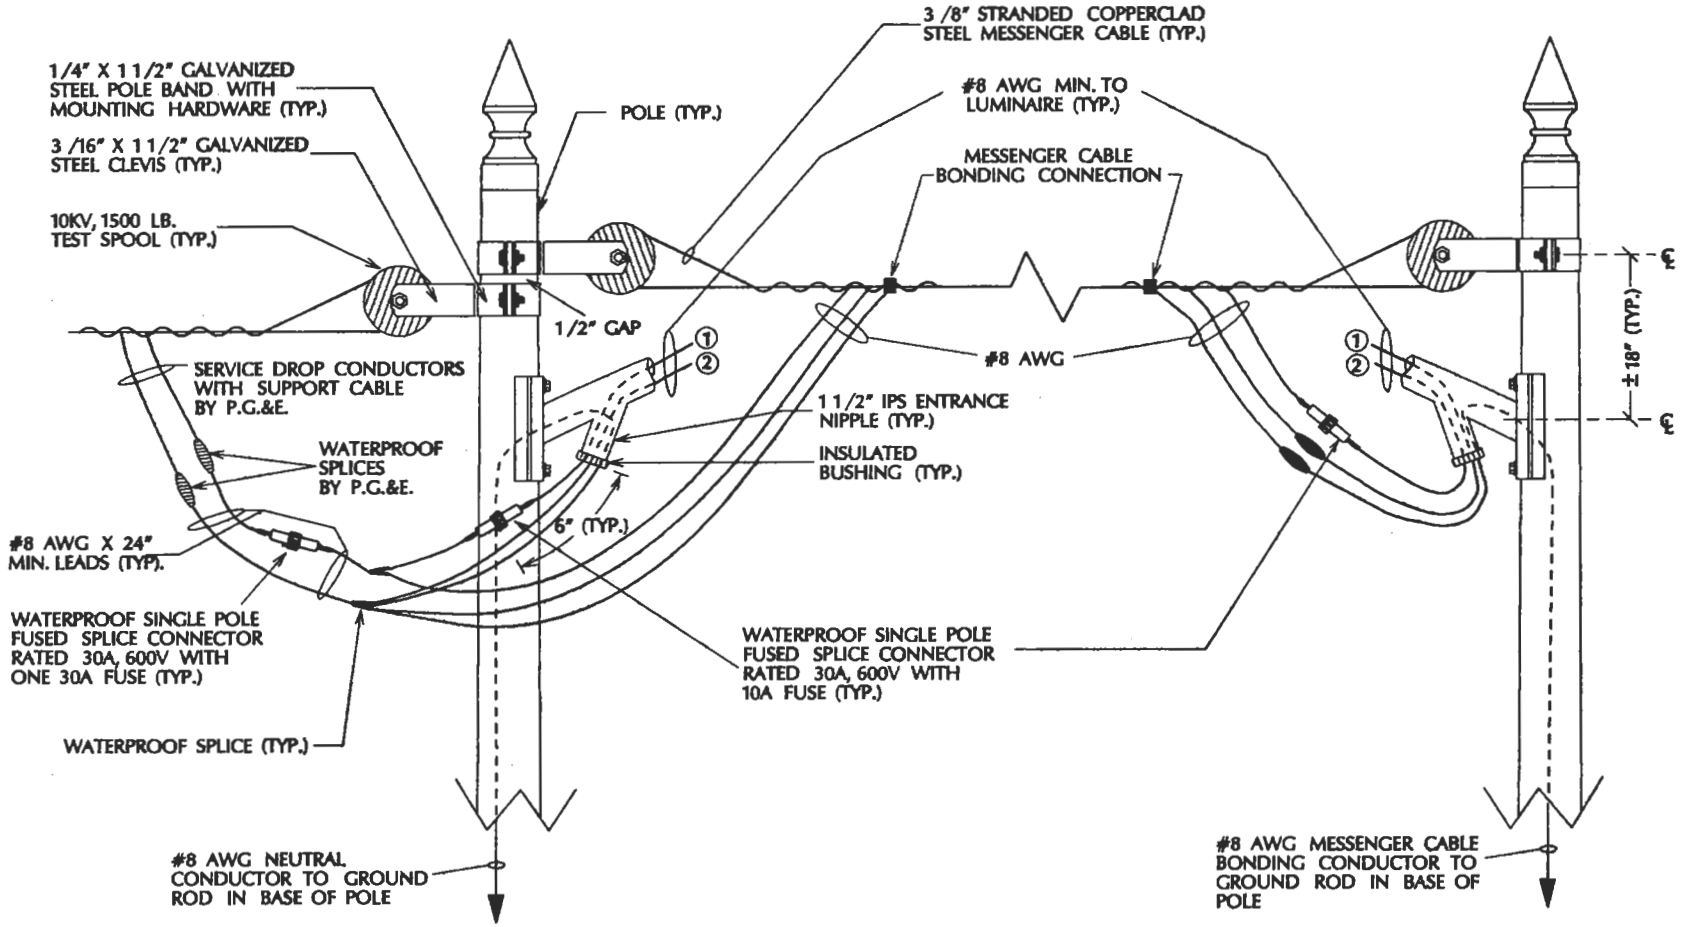

CONDUCTORS:
① UNGROUNDED
② NEUTRAL

NOTES:
1. SEE DWGS. E-41 AND E-42 FOR POLE GROUNDING REQUIREMENTS.
2. SEE DWG. E-45 FOR NOTES.
3. GROUND THE MESSENGER AS REQUIRED BY NATIONAL ELECTRICAL CODE.

APPROVED BY
DATE 2/3/92

120V OVERHEAD MULTIPLE STREETLIGHT SERVICE TYPE – IIC

DEPARTMENT OF PUBLIC WORKS

CITY OF SAN JOSE CALIFORNIA

DRAWING NO. E-43