APPROVED BY
DATE 3/3/92

240V OVERHEAD MULTIPLE STREETLIGHT SERVICE TYPE – IID

DEPARTMENT OF PUBLIC WORKS

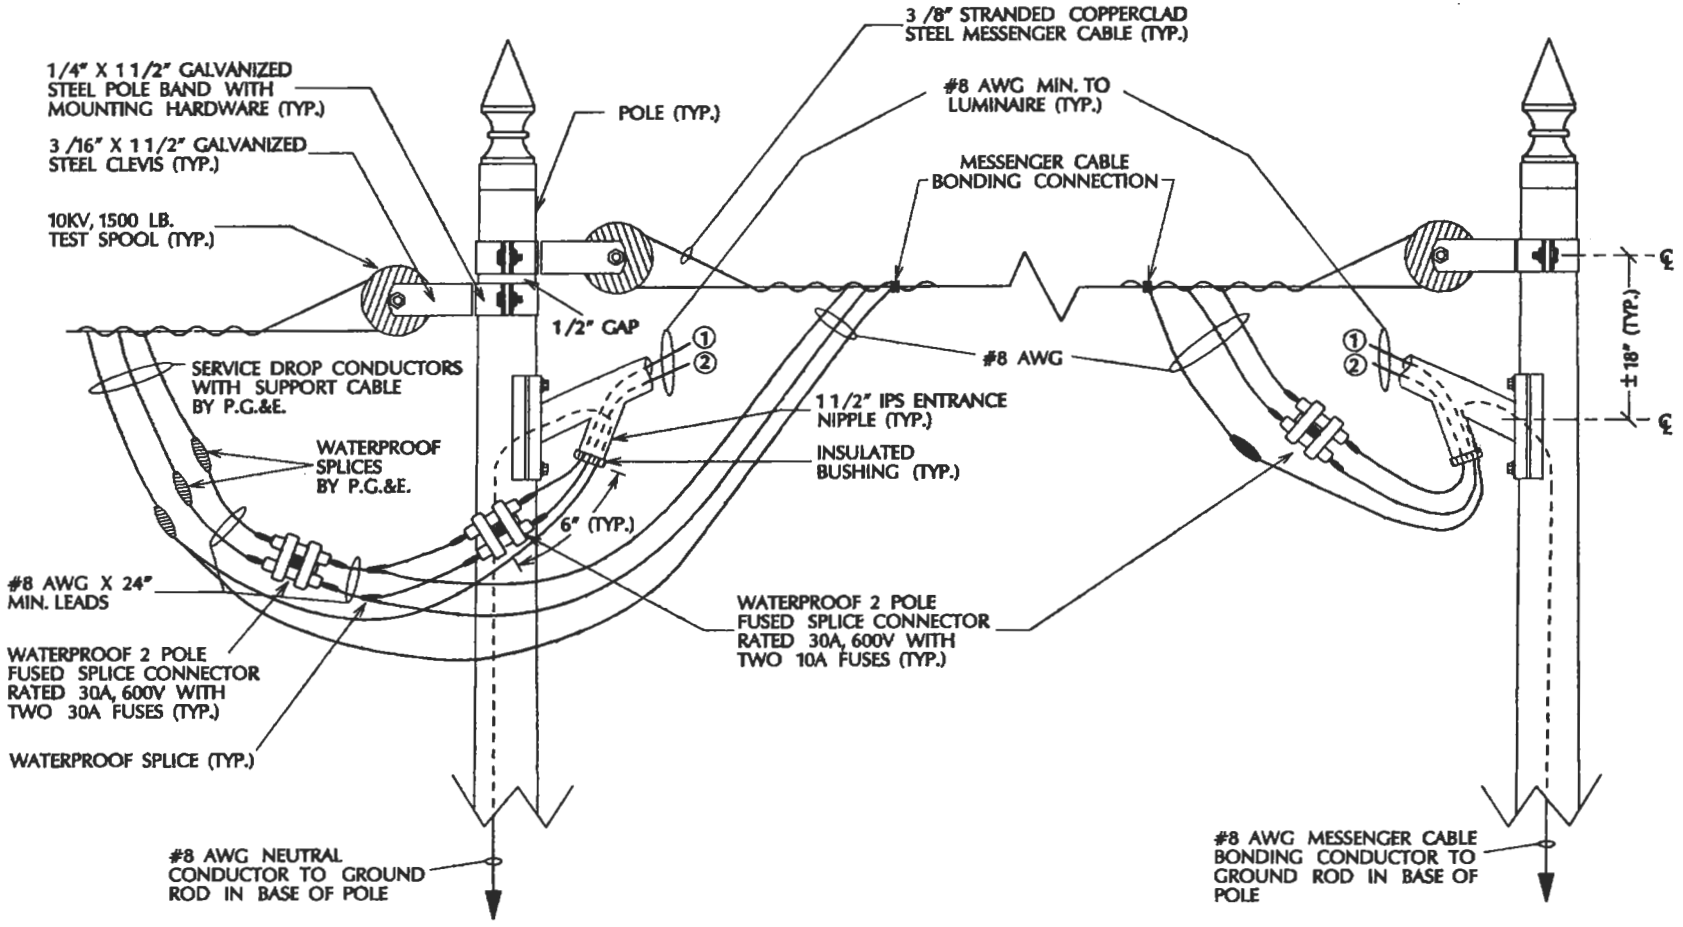

CONDUCTORS:
① UNGROUNDED
② UNGROUNDED

NOTES:
1. SEE DRAWINGS E-41 AND E-42 FOR POLE GROUNDING REQUIREMENTS.
2. SEE DRAWING E-45 FOR NOTES.
3. GROUND THE MESSENGER AS REQUIRED BY NATIONAL ELECTRICAL CODE.

DRAWING NO. E-44