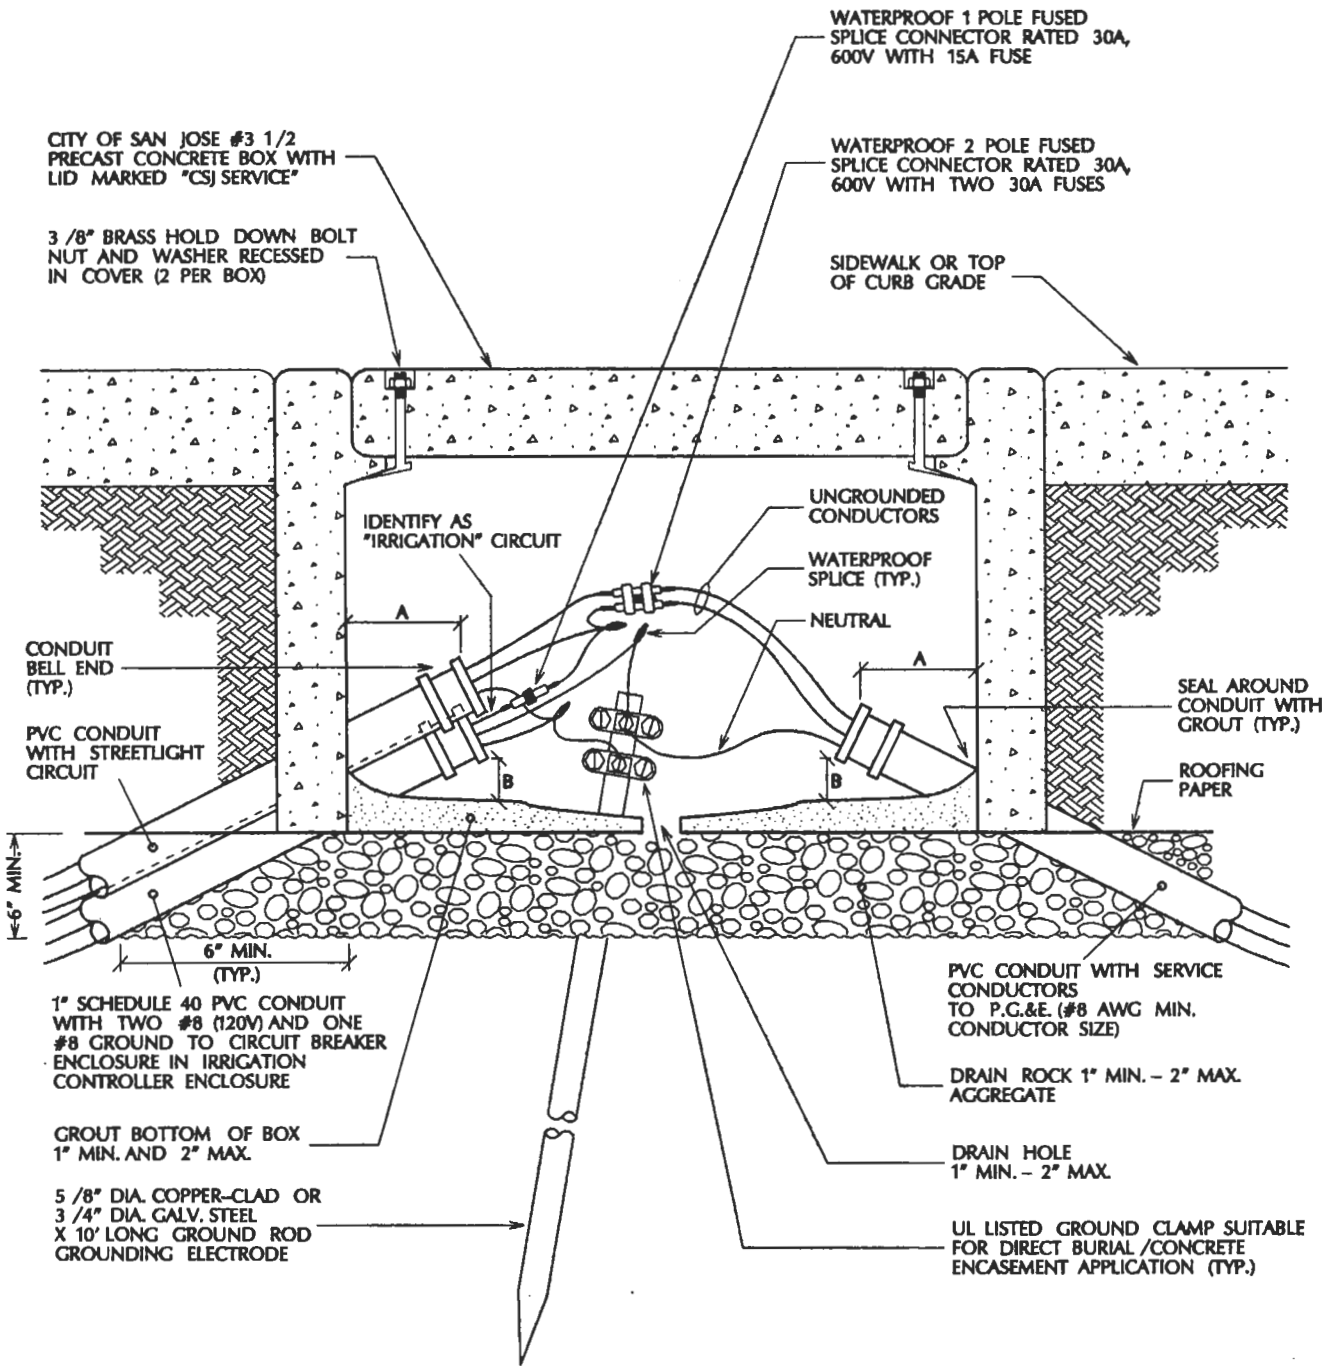

DIMENSION A: 1" MIN., 2" MAX. (TYP. – ALL CONDUITS)
" B: 1" MIN, 2" MAX. ABOVE GROUT (TYP. – ALL CONDUITS)

NOTES:

1. IF PULLBOX IS EXISTING, THE GROUT SHALL BE REPAIRED.
2. IF RIGID STEEL CONDUIT IS PRESENT, BONDING SHALL BE AS PER CITY OF SAN JOSE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION.
3. ALL WORK SHALL COMPLY WITH CITY OF SAN JOSE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION. PROVIDE 3' OF SLACK IN ALL CONDUCTORS IN ACCORDANCE WITH SPECIFICATIONS. (SLACK NOT SHOWN).
4. SEE NOTES DRAWINGS E-04, E-05, E-06, AND E-37.

APPROVED BY	IRRIGATION CONTROLLER CONNECTION AT UNDERGROUND STREETLIGHT SERVICE		DRAWING NO.
DATE 3/3/92	DEPARTMENT OF PUBLIC WORKS	CITY OF SAN JOSE CALIFORNIA	E-39