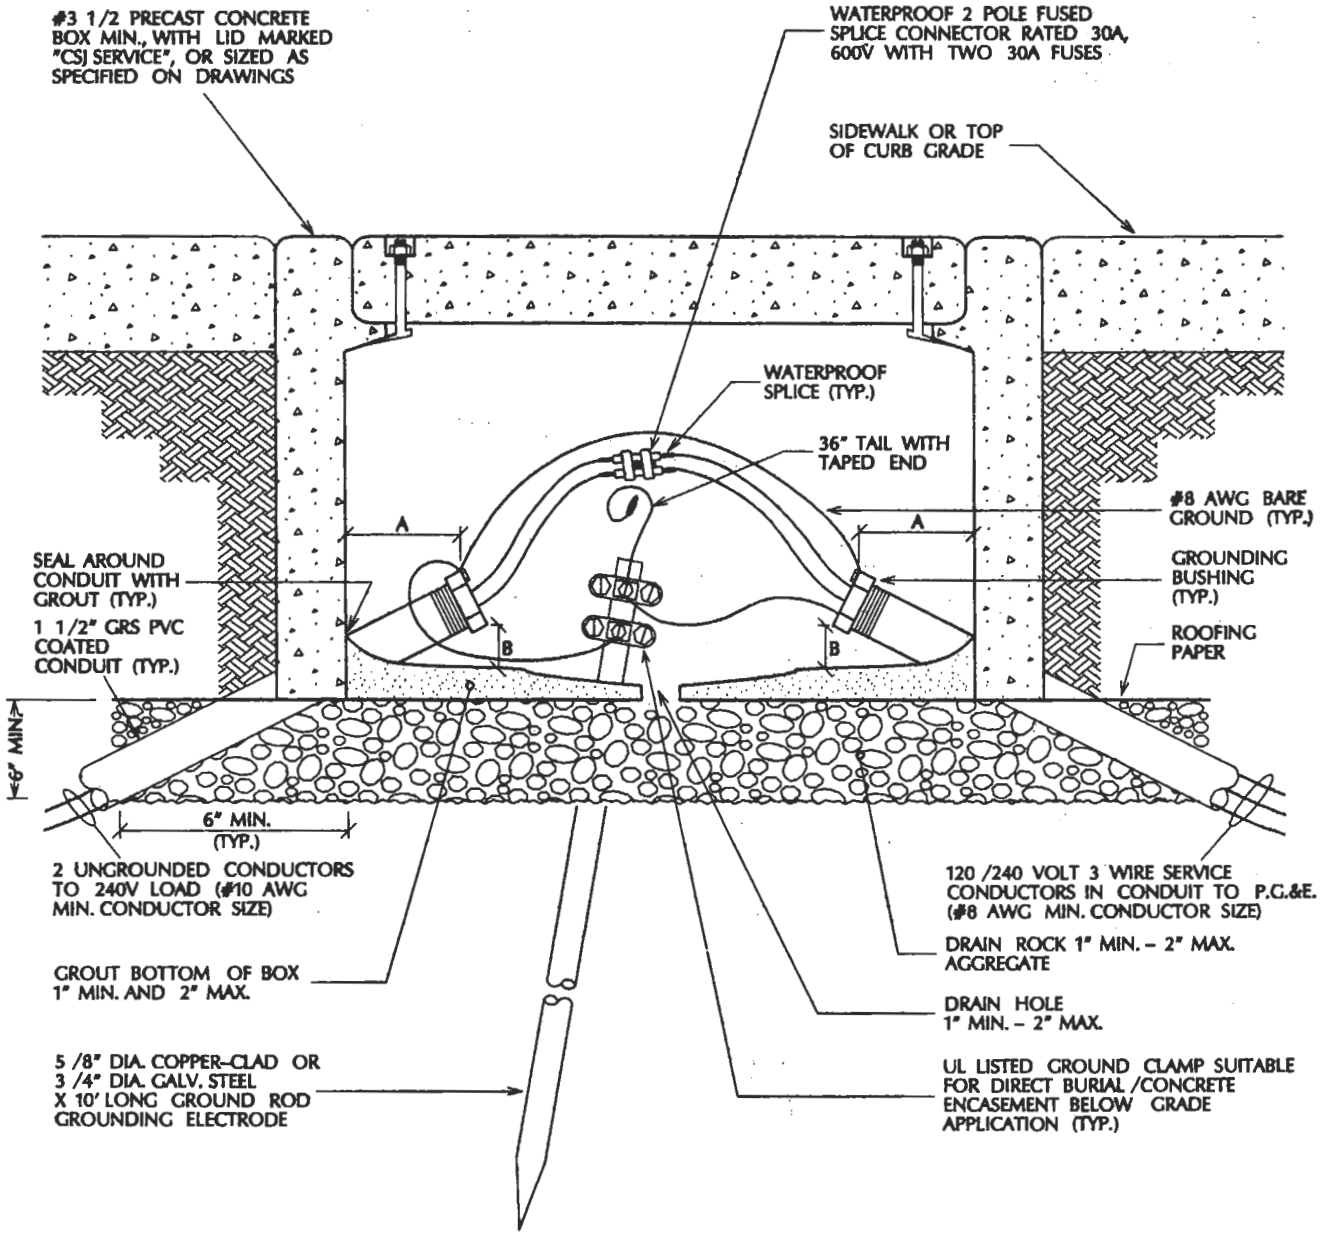

DIMENSION A: 1" MIN., 2" MAX. (TYP. – ALL CONDUITS)
" B: 1" MIN, 2" MAX. ABOVE GROUT (TYP. – ALL CONDUITS)

NOTES:
1. SEE NOTES DRAWINGS E-04, E-05, E-06, AND E-37.
2. PROVIDE 3' OF SLACK IN ALL CONDUCTORS IN ACCORDANCE WITH SPECIFICATIONS. (SLACK NOT SHOWN).

APPROVED BY	UNDERGROUND STREETLIGHT SERVICE TYPE ID – 240V		DRAWING NO.
DATE 3/3/92	DEPARTMENT OF PUBLIC WORKS	CITY OF SAN JOSE CALIFORNIA	E-36