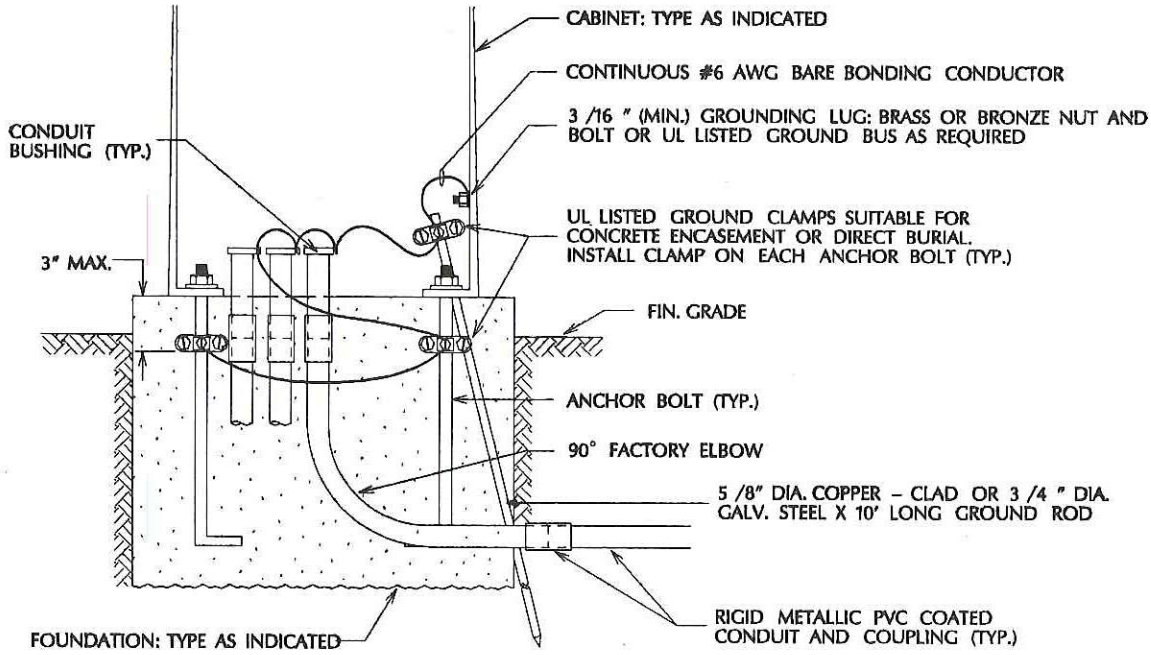

NOTES:

1. BONDING /GROUNDING DETAIL FOR USE WITH GALVANIZED RIGID STEEL PVC COATED CONDUIT.
2. THE GROUND ROD SHALL BE INSTALLED OBLIQUELY THROUGH THE FOUNDATION IN UNDISTURBED SOIL AT AN ANGLE NOT TO EXCEED 45 DEGREES FROM THE VERTICAL.

APPROVED BY	CABINET BONDING /GROUNDING METHOD B		DRAWING NO.
DATE 3/3/92	DEPARTMENT OF PUBLIC WORKS	CITY OF SAN JOSE CALIFORNIA	E–52